


## SEWER SERVICE VALVE

- A SEWER SERVICE VALVE IS TO BE INSTALLED ON ALL 4" SEWER SERVICE LINES WHERE LIBERTY ONLY PROVIDES SEWER SERVICE.
- A SEWER VALVE IS TO BE INSTALLED IN THE BACK OF THE PUE AT THE PROPERTY LINE.
- UNDER NO CIRCUMSTANCES SHALL A SEWER VALVE BE INSTALLED WITHIN A PAVED AREA, CURB & GUTTER, PAVERS, OR SIDEWALK.
- THE PLUG AND HANDLE IS TO BE INSTALLED WITH EACH SEWER SERVICE VALVE. THE HANDLE SHALL BE INSTALLED TO THE APPROPRIATE LENGTH, MEANING THE TOP OF THE HANDLE SHALL BE POSITIONED JUST BELOW THE THREADED CAP.
- ALL SEWER VALVES AND 45 BENDS IN SEWER LATERALS ARE TO BE IDENTIFIED BY SURVEY AND ADDED TO THE AS-BUILTS.
- SEWER SERVICE VALVES NEED TO BE ACCEPTED AT FINAL GRADE PRIOR TO APPROVALS FROM LIBERTY ENGINEERING.
- ANY CHANGES ARE TO BE APPROVED IN WRITING BY THE INSPECTOR.

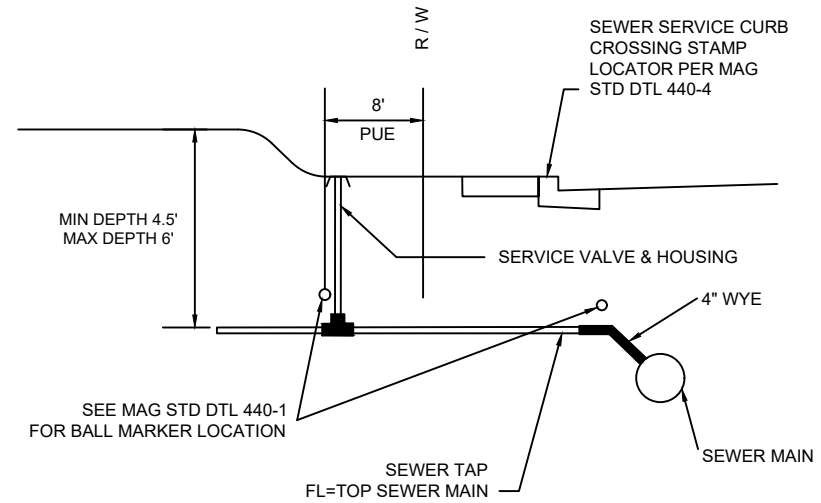

## SEWER SERVICE WITH VALVE

- FOR DEEP SEWERS THE CONTRACTOR IS TO INSTALL 45 DEGREE BENDS TO BRING SERVICE TO 5' DEPTH (6' MAX) PRIOR TO THE SEWER SERVICE VALVE. THE MAX DEPTH OF THE SEWER SERVICE VALVE IS 6'.
- SEWER SERVICE VALVE IS TO BE PLACED IN THE BACK OF THE PUE AT THE PROPERTY LINE.
- SEWER SERVICE SHALL BE ADDITIONALLY MARKED WITH TRACER WIRE AND CONNECTED TO THE MAIN LINE TRACER
- ALL SEWER VALVES AND 45 BENDS IN SEWER LATERALS ARE TO BE IDENTIFIED BY SURVEY AND ADDED TO THE AS-BUILTS.
- ANY CHANGES ARE TO BE APPROVED IN WRITING BY THE INSPECTOR.

# STANDARD DRAWINGS TYPICAL SEWER SERVICE AND VALVE

14920 W Camelback Rd.  
Litchfield Park, AZ 85340  
Phone: 623-935-9367



STD. DWG.  
No. LLP-201

DATE:  
1/27/2022

SHT 1 OF 1